

GM9000iED Cancellation of Bonded Neutral Grounding Instructions

2022.7.8


Disassemble and operate as the following





Pull the front cover from here by hand


2022.07.08 09:43

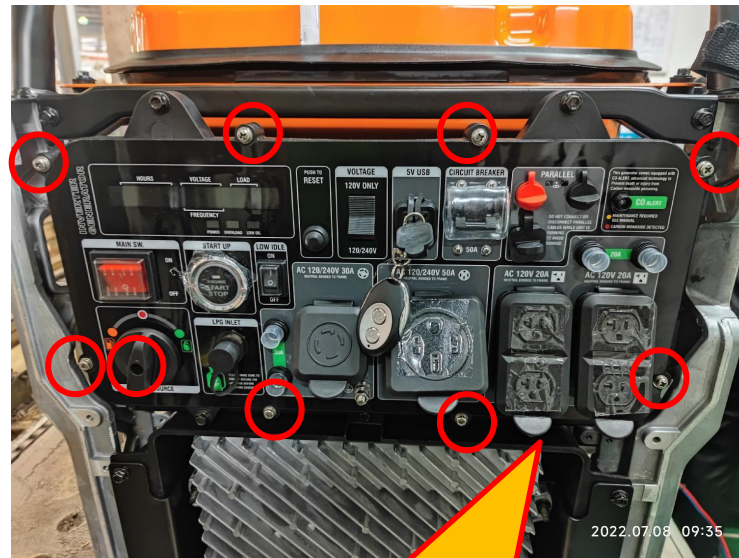


Unscrew these 9 screws with a Phillips screwdriver or electric gun and pull the panel out some distance



View and operate from this direction after pulling out the panel

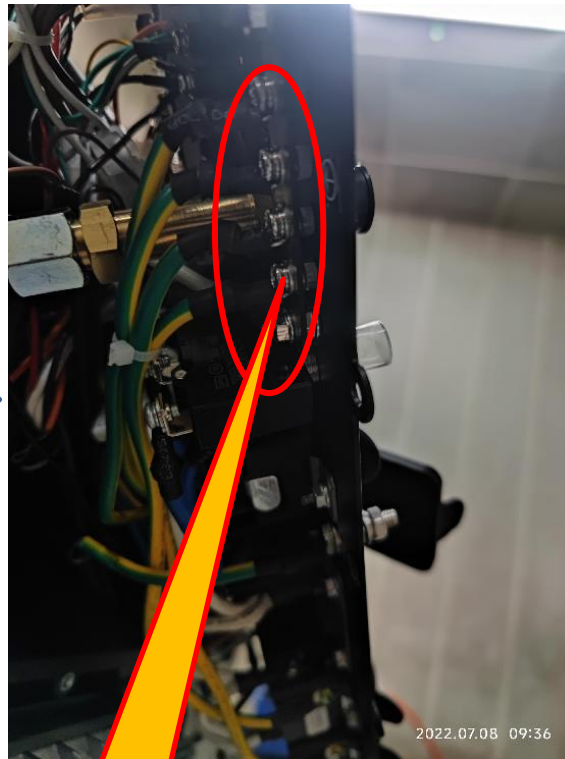


find the terminal block


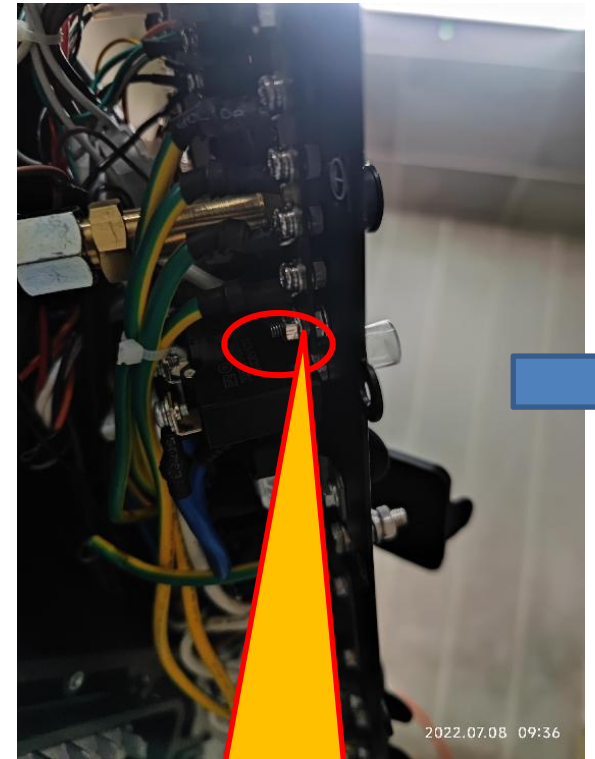


Locate the bolts that hold the white wire on the terminal block and use a wrench to unscrew the nut



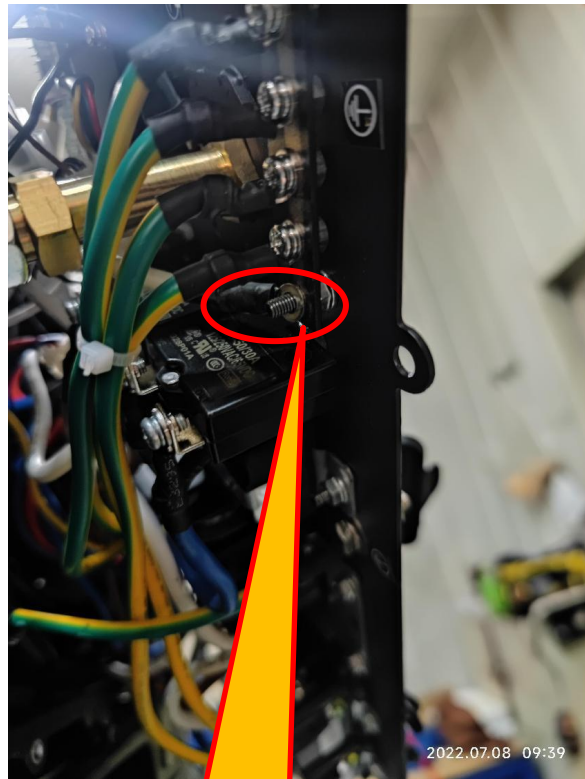

Remove the white wire terminal

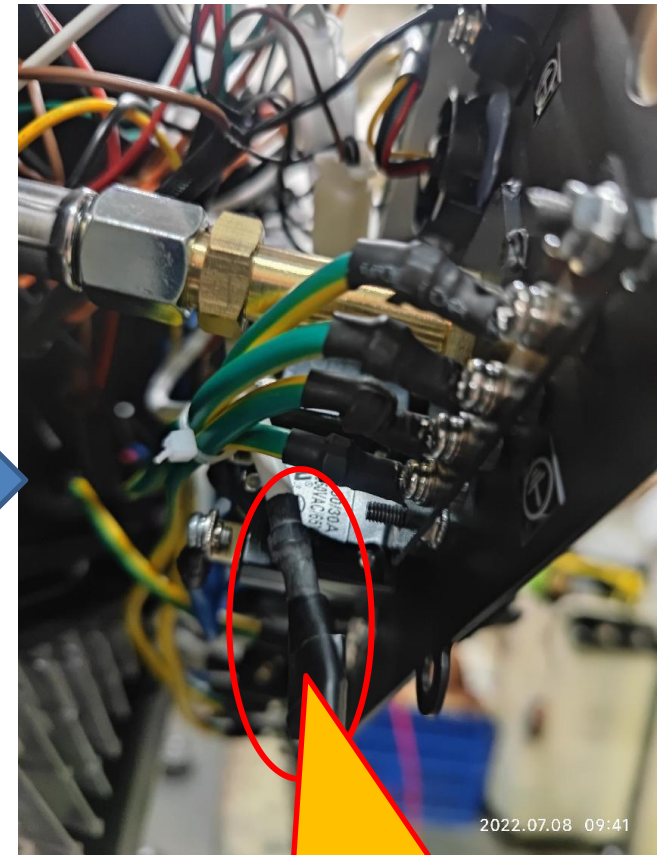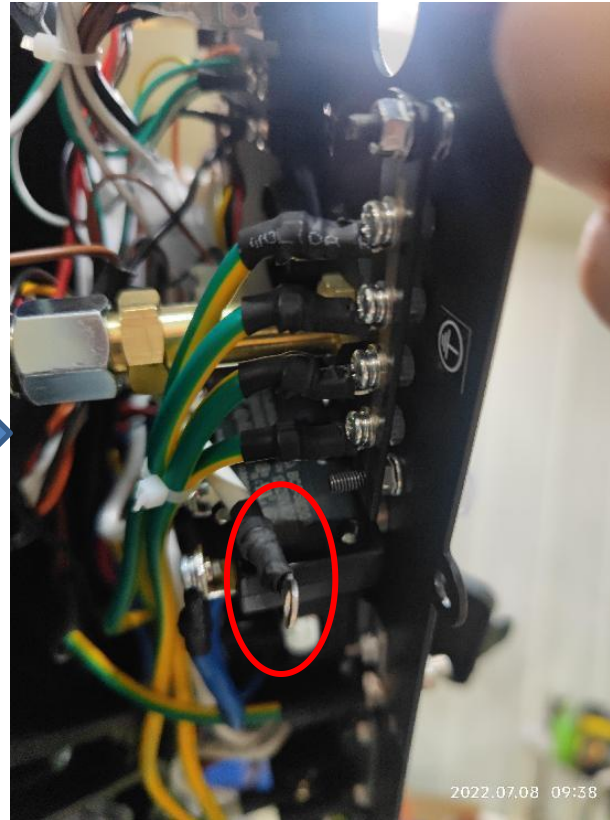

Wrap the removed white wire terminal with insulating tape, and then restore the unit to complete the operation of canceling the neutral grounding.

Thank you !